



**Technical Report No.: 64.181.23.03117.01 Rev.00**

**Date: 2023-11-07**

Client: Name: Guangzhou Sprsun New Energy Technology Development Co., Ltd  
 Address: No.15 Tangxi Road, Yinsha Industrial Park, Xintang, Zengcheng District, Guangzhou, 511338, China  
 Contact person: YE XIN

Manufacturer: Name: Guangzhou Sprsun New Energy Technology Development Co., Ltd  
 Address: No.15 Tangxi Road, Yinsha Industrial Park, Xintang, Zengcheng District, Guangzhou, 511338, China

Factory: Name: Guangzhou Sprsun New Energy Technology Development Co., Ltd  
 Address: No.15 Tangxi Road, Yinsha Industrial Park, Xintang, Zengcheng District, Guangzhou, 511338, China

Test object: Product: DC Inverter Air Source Heat Pumps  
 Model: CGK030V4P, CGK040V4P, CGK050V4P, CGK060V4P  
 Trade mark: SPRSUN

Test specification:  EN 14825:2022  
 EN 12102-1:2022  
 EN 14511-3:2022  
 EN 14511-4:2022 Clause 4

Purpose of examination: Test according to the test specification  
 (EU) No 813/2013  
 EU 2016/2282:2016-11-30

Test result: The test results show that the presented product is in compliance with the above listed test specifications.

Any use for advertising purposes must be granted in writing. This technical report may only be quoted in full. This report is the result of a single examination of the object in question. It does not imply a general statement regarding the quality of products from regular production. For further details please see testing and certification regulation, chapter A-3.4.

Doc No.: ITC-TTW0902.02E – Rev.13

## 1 Description of the test object

### 1.1 Function

Manufacturer's specification for intended use:

The appliance is air to water heat pump.

Manufacturer's specification for predictive use:

According to user manual

### 1.2 Consideration of the foreseeable use

- Not applicable
- Covered through the applied standard
- Covered by the following comment
- Covered by attached risk analysis

### 1.3 Technical Data

Model :	CGK030V4P, CGK040V4P, CGK050V4P, CGK060V4P
Rated Voltage (V) :	220-240V~
Rated Frequency (Hz) :	50
Rated Power (W) :	4360 for CGK030V4P; 5050 for CGK040V4P; 6800 for CGK050V4P; 7830 for CGK060V4P
Rated Current (A) :	20.86 for CGK030V4P; 24.18 for CGK040V4P; 32.54 for CGK050V4P; 37.50 for CGK060V4P
Protection Class :	Class I
Protection Against Moisture :	IP X4
Construction :	Stationary
Supply connection :	<input type="checkbox"/> Non detachable cord <input checked="" type="checkbox"/> Permanent connection to fixed wiring
Operation mode:	<input checked="" type="checkbox"/> Continuous operation; <input type="checkbox"/> Intermittent operation; <input type="checkbox"/> Short time operation;
Refrigerant/charge (kg) :	R290 / 0.80 for CGK030V4P; 1.00 for CGK040V4P; 1.20 for CGK050V4P; 1.80 for CGK060V4P
Declared parameters :	<input checked="" type="checkbox"/> Average <input type="checkbox"/> Warmer <input type="checkbox"/> Colder
Sound power level dB(A) :	N/A
Series No :	KAL092210600200123 for CGK030V4P; KAL092210600300034 for CGK040V4P; KAL092210600400035 for CGK050V4P; KAL092210600500116 for CGK060V4P

## 2 Order

### 2.1 Date of Purchase Order, Customer's Reference

Date of Purchase Order: 2023-08-31

Customer's Reference: Guangzhou Sprsun New Energy Technology Development Co., Ltd

### 2.2 Test Sample(s)

• Reception date(s): 2023-08-31

• Location(s) of reception:

For Energy test:

Guangzhou Customs District Technology Center  
(CNAS accredited laboratory with Registration No.CNAS L2322)

Address: No.3, Desheng East Road, Daliang, Shunde District, Foshan, Guangdong, China

For Noise tests:

CVC Testing Technology Co., Ltd.  
(CNAS accredited laboratory with Registration No.CNAS L0095)

Address: No.3, Tiantai Yilu, Kaitai Avenue, Science City, Guangzhou, Guangdong, China

• Condition of test sample(s): completed and can be normal operation

### 2.3 Date(s) of Testing

2023-08-31 to 2023-10-30

### 2.4 Location(s) of Testing

Same as 2.2

### 2.5 Points of Non-compliance or Exceptions of the Test Procedure

N/A

## 3 Test Results

Decision rule according to ILAC-G8:09/2019 clause 4.2.1 Binary statement for simple acceptance rule or IEC Guide 115:2023, clause 4.3 Simple acceptance was applied.

Decision rule according to customer's requirements was applied. It is:

Decision rule according to ILAC-G8:09/2019 clause 4.2.2 Binary statement with guard band - guard band length = 95 % extended measurement uncertainty, was applied.

Decision rule (based on ILAC-G8:09/2019 clause 4.2.3 Non-binary statement with guard band, guard band length = 95 % extended measurement uncertainty) for an upper specification limit (A lower limit or specification with an up-per and a lower limit is treated similarly.):

• **Compliance with the requirement:** If a specification limit is not breached by a measurement result plus the expanded uncertainty with a 95% coverage probability, then compliance with the specification will be stated (e. g. Pass).

• **Non-compliance with the requirement:** If a specification limit is exceeded by the measurement result minus the expanded uncertainty with a 95% coverage probability, then non-compliance with the specification will be stated (e. g. Fail).

• **Inconclusive result:** If a measurement result plus/minus the expanded uncertainty with a 95 % coverage probability overlaps the limit it will be stated that it is not possible to state compliance or non-compliance.

There are no statements to conformity or no results with measurand stated in this report, no decision rule has been applied.

**3.1 Positive Test Results**

See Appendix I

**4 Remarks**

**4.1 General**

The user manual has been examined according to the minimum requirements described in the product standard. The manufacturer is responsible for the accuracy of further particulars as well as of the composition and layout.

**4.2** When the product is placed on the market, it must be accompanied with safety Instructions written in official language of the country. The instructions shall give information regarding safe operation, installation and maintenance.

**5 Documentation**

- Appendix I: Test results
- Appendix II: Marking plate
- Appendix III: photo documentation
- Appendix IV: Construction data form
- Appendix V: Test equipment list

**6 Test History**

- 1) These appliances are Air To Water Heat Pump Unit, each one including a whole compression type refrigerant circuit to heat water in another circuit. These appliances were for cooling and heating water function, this report only for heating capacity test.
- 2) The main power is supplied by a 3-pole supply cord connecting to fixed wiring.
- 3) Water enthalpy method was adopted in this report.
- 4) Standby mode power, off mode power and thermostat-off mode power were tested according to clause 12 of standard EN 14825:2022.


Doc No.: ITC-TTW0902.02E – Rev.13

**TÜV SÜD Certification and Testing (China) Co., Ltd. Guangzhou Branch  
TÜV SÜD Group**

Tested by: William Liang, Project Handler  
*printed name, function & signature*



Approved by: Plum Li, Designated Reviewer  
*printed name, function & signature*



Appendix I Test results

Table 1.	Heating mode (Low temperature application):						P	
Model	CGK030V4P							
Product type	Air to Water	Heating season	<input checked="" type="checkbox"/>	Average	<input type="checkbox"/>	Warmer	<input type="checkbox"/>	Colder
<b>1. Test conditions:</b>								
Condition	Part Load Ratio in %		Outdoor heat exchanger		Indoor heat exchanger			
	Formula	Average climates	Inlet dry (wet) bulb temperature (°C)		Inlet/outlet water temperatures (°C)			
A	$(-7-16)/(T_{designh-16})$	88	-7(-8)		a / 34			
B	$(+2-16)/(T_{designh-16})$	54	2(1)		a / 30			
C	$(+7-16)/(T_{designh-16})$	35	7(6)		a / 27			
D	$(+12-16)/(T_{designh-16})$	15	12(11)		a / 24			
E	$(TOL-16)/(T_{designh-16})$		TOL		a / 35.3			
F	$(T_{bivalent-16})/(T_{designh-16})$		T <sub>biv</sub>		a / 34			
G	$(-15-16)/(T_{designh-16})$	N/A	-15		N/A			
Remark: a) With the water flow rate as determined at the standard rating conditions given in EN14511-2 at 30/35 conditions, the capacity is 7.517kW, the power is 1.663kW, the COP is 4.52kW/kW.								
<b>2. Tested data/correction data(Average):</b>								
General test conditions/ Part-Load	Unit	A(-7)/W34 (88%)	A2/W30 (54%)	A7/W27 (35%)	A12/W24 (15%)	A(-10)/ W35.3 (100%)	A(-7)/W34 (88%)	
	--	A	B	C	D	E	F	
Data collection period	hh: min:sec	3:00:00	1:10:00	1:10:00	1:10:00	3:00:00	3:00:00	
The heat pump defrosts	--	Yes	No	No	No	Yes	Yes	
<b>Electrical Properties</b>								
Voltage	V	230.5	229.9	230.2	230.3	230.5	230.5	
Current input of the unit	A	9.26	3.71	3.47	3.10	9.36	9.26	
Power input of the unit	kW	2.096	0.786	0.732	0.645	2.119	2.096	
Compressor frequency	Hz	70	30	30	30	70	70	

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

Test conditions User Side							
Water flow	m³/h	1.32	1.32	1.32	1.32	1.32	1.32
Inlet Water temperature	°C	29.72	27.48	25.48	23.31	31.29	29.72
Outlet Water temperature	°C	33.68*	29.99	28.40	26.62	34.96*	33.68*
Test conditions Source Side							
Barometric pressure	kPa	101.02	101.01	101.01	101.02	101.01	101.02
Air inlet temperature, DB	°C	-6.98	2.01	7.02	12.01	-9.99	-6.98
Air inlet temperature, WB	°C	-7.98	1.00	6.00	11.00	-10.96	-7.98
Summary of the results							
Total heating capacity	kW	6.012	3.831	4.443	5.046	5.569	6.012
Effective power input	kW	2.066	0.757	0.703	0.616	2.089	2.066
Coefficient of performance (COP)	kW/kW	2.91	5.06	6.32	8.20	2.67	2.91
Remark: * In part condition, outlet temperature data is recorded by the full average complete cycle's data.							

Electric power consumptions	Unit	Value
Thermostat-off mode [P <sub>TO</sub> ]	kW	0.026
Standby mode [P <sub>SB</sub> ]	kW	0.014
Crankcase heater [P <sub>CK</sub> ]	kW	0.043
Off mode [P <sub>OFF</sub> ]	kW	0.014

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

3.Calculation/conclusion for SCOP:						
Tdesignh(°C):	-10	Tbiv(°C) :	-7			
Pdesignh(kW):	6.796	TOL(°C) :	-10			
Test result A, B, C, D, E, F conditions:						
Condition	Part load	Measured capacity	Measured COP	Cdh	CR	COP at part load
E	6.796	5.569	2.67	0.90	1.00	2.67
F	6.012	6.012	2.91	0.90	1.00	2.91
A	6.012	6.012	2.91	0.90	1.00	2.91
B	3.659	3.831	5.06	0.90	0.96	5.06
C	2.352	4.443	6.32	0.90	0.53	5.81
D	1.046	5.046	8.20	0.90	0.21	5.93
CR: part load divided by capacity;						

Conclusions:	Unit	Value
SCOPon:	kWh/kWh	4.78
SCOP:	kWh/kWh	4.76
QH:	kWh/year	14040
QHE:	kWh/year	2951
$\eta_{s,h}$	%	187.3
Seasonal space heating energy efficiency classes: (According (EU) No 811/2013 Table 2)	--	A+++

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

<b>Table 2.</b>	<b>Heating mode (Medium temperature application):</b>							<b>P</b>
<b>Model</b>	CGK030V4P							
<b>Product type</b>	Air to Water	<b>Heating season</b>	<input checked="" type="checkbox"/>	Average	<input type="checkbox"/>	Warmer	<input type="checkbox"/>	Colder
<b>1. Test conditions:</b>								
Condition	Part Load Ratio in %		Outdoor heat exchanger		Indoor heat exchanger			
	Formula	Average climates	Inlet dry (wet) bulb temperature (°C)		Inlet/outlet water temperatures (°C)			
A	$(-7-16)/(T_{designh-16})$	88	-7(-8)		a / 52			
B	$(+2-16)/(T_{designh-16})$	54	2(1)		a / 42			
C	$(+7-16)/(T_{designh-16})$	35	7(6)		a / 36			
D	$(+12-16)/(T_{designh-16})$	15	12(11)		a / 30			
E	$(TOL-16)/(T_{designh-16})$		TOL		a / 55.3			
F	$(T_{bivalent-16})/(T_{designh-16})$		T <sub>biv</sub>		a / 52			
G	$(-15-16)/(T_{designh-16})$	N/A	-15		N/A			
Remark: a) With the water flow rate as determined at the standard rating conditions given in EN14511-2 at 47/55 conditions, the capacity is 6.839kW, the power is 2.245kW, the COP is 3.05kW/kW.								
<b>2. Tested data/correction data(Average):</b>								
General test conditions/ Part-Load	Unit	A(-7)/W52 (88%)	A2/W42 (54%)	A7/W36 (35%)	A12/W30 (15%)	A(-10)/ W55.3 (100%)	A(-7)/W52 (88%)	
	--	A	B	C	D	E	F	
Data collection period	hh: min:sec	3:00:00	1:10:00	1:10:00	1:10:00	3:00:00	3:00:00	
The heat pump defrosts	--	Yes	No	No	No	Yes	Yes	
<b>Electrical Properties</b>								
Voltage	V	230.2	231.2	231.2	231.2	230.2	230.2	
Current input of the unit	A	10.76	4.38	4.01	3.61	10.87	10.76	
Power input of the unit	kW	2.443	0.951	0.867	0.773	2.469	2.443	
Compressor frequency	Hz	80	30	30	30	70	80	

Doc No.: ITC-TTW0902.02E – Rev.13



**Appendix I Test results**

<b>Test conditions User Side</b>							
Water flow	m <sup>3</sup> /h	0.75	0.75	0.75	0.75	0.75	0.75
Inlet Water temperature	°C	45.24	37.94	33.57	28.93	49.04	45.24
Outlet Water temperature	°C	51.48*	42.06	38.40	34.52	54.81*	51.48*
<b>Test conditions Source Side</b>							
Barometric pressure	kPa	99.85	99.85	99.85	99.80	99.75	99.85
Air inlet temperature, DB	°C	-6.99	2.00	7.00	12.01	-10.00	-6.99
Air inlet temperature, WB	°C	-7.84	1.00	6.00	11.00	-11.06	-7.84
<b>Summary of the results</b>							
Total heating capacity	kW	5.353	3.549	4.160	4.825	4.942	5.353
Effective power input	kW	2.424	0.932	0.848	0.754	2.450	2.424
Coefficient of performance (COP)	kW/kW	2.21	3.81	4.91	6.40	2.02	2.21
Remark: * In part condition, outlet temperature data is recorded by the full average complete cycle's data.							

<b>Electric power consumptions</b>	<b>Unit</b>	<b>Value</b>
Thermostat-off mode [P <sub>TO</sub> ]	kW	0.026
Standby mode [P <sub>SB</sub> ]	kW	0.014
Crankcase heater [P <sub>CK</sub> ]	kW	0.043
Off mode [P <sub>OFF</sub> ]	kW	0.014

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

3.Calculation/conclusion for SCOP:						
Tdesignh(°C):	-10	Tbiv(°C) :	-7			
Pdesignh(kW):	6.051	TOL(°C) :	-10			
Test result A, B, C, D, E, F conditions:						
Condition	Part load	Measured capacity	Measured COP	Cdh	CR	COP at part load
E	6.051	4.942	2.02	0.90	1.00	2.02
F	5.353	5.353	2.21	0.90	1.00	2.21
A	5.353	5.353	2.21	0.90	1.00	2.21
B	3.258	3.549	3.81	0.90	0.92	3.81
C	2.094	4.160	4.91	0.90	0.50	4.47
D	0.931	4.825	6.40	0.90	0.19	4.51
CR: part load divided by capacity;						

Conclusions:	Unit	Value
SCOPon:	kWh/kWh	3.63
SCOP:	kWh/kWh	3.62
QH:	kWh/year	12501
QHE:	kWh/year	3455
$\eta_{s,h}$	%	141.7
Seasonal space heating energy efficiency classes: (According (EU) No 811/2013 Table 1)	--	A++

Doc No.: ITC-TTW0902.02E -- Rev.13

Appendix I Test results

<b>Table 3.</b>	<b>Heating mode (Low temperature application):</b>							<b>P</b>
<b>Model</b>	CGK040V4P							
<b>Product type</b>	Air to Water	<b>Heating season</b>	<input checked="" type="checkbox"/>	Average	<input type="checkbox"/>	Warmer	<input type="checkbox"/>	Colder
<b>1. Test conditions:</b>								
Condition	Part Load Ratio in %		Outdoor heat exchanger		Indoor heat exchanger			
	Formula	Average climates	Inlet dry (wet) bulb temperature (°C)		Inlet/outlet water temperatures (°C)			
A	$(-7-16)/(T_{designh-16})$	88	-7(-8)		a / 34			
B	$(+2-16)/(T_{designh-16})$	54	2(1)		a / 30			
C	$(+7-16)/(T_{designh-16})$	35	7(6)		a / 27			
D	$(+12-16)/(T_{designh-16})$	15	12(11)		a / 24			
E	$(TOL-16)/(T_{designh-16})$		TOL		a / 35.3			
F	$(T_{bivalent-16})/(T_{designh-16})$		T <sub>biv</sub>		a / 34			
G	$(-15-16)/(T_{designh-16})$	N/A	-15		N/A			
Remark: a) With the water flow rate as determined at the standard rating conditions given in EN14511-2 at 30/35 conditions, the capacity is 7.937kW, the power is 1.710kW, the COP is 4.64kW/kW.								
<b>2. Tested data/correction data(Average):</b>								
General test conditions/ Part-Load	Unit	A(-7)/W34 (88%)	A2/W30 (54%)	A7/W27 (35%)	A12/W24 (15%)	A(-10)/ W35.3 (100%)	A(-7)/W34 (88%)	
	--	A	B	C	D	E	F	
Data collection period	hh: min:sec	3:00:00	1:10:00	1:10:00	1:10:00	3:00:00	3:00:00	
The heat pump defrosts	--	Yes	No	No	No	Yes	Yes	
<b>Electrical Properties</b>								
Voltage	V	230.3	230.4	230.5	230.5	230.4	230.3	
Current input of the unit	A	10.27	4.07	3.20	2.85	10.64	10.27	
Power input of the unit	kW	2.337	0.876	0.671	0.589	2.422	2.337	
Compressor frequency	Hz	83	35	30	30	83	83	

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

Test conditions User Side							
Water flow	m³/h	1.40	1.40	1.40	1.40	1.40	1.40
Inlet Water temperature	°C	29.44	27.29	25.31	23.27	31.00	29.44
Outlet Water temperature	°C	33.63*	29.95	27.97	26.32	35.00*	33.63*
Test conditions Source Side							
Barometric pressure	kPa	101.02	101.01	101.01	101.02	101.01	101.02
Air inlet temperature, DB	°C	-7.00	2.00	7.00	12.01	-10.00	-7.00
Air inlet temperature, WB	°C	-7.99	1.00	6.00	11.00	-10.95	-7.99
Summary of the results							
Total heating capacity	kW	6.771	4.302	4.309	4.940	6.456	6.771
Effective power input	kW	2.330	0.870	0.665	0.583	2.415	2.330
Coefficient of performance (COP)	kW/kW	2.91	4.95	6.48	8.47	2.67	2.91
Remark: * In part condition, outlet temperature data is recorded by the full average complete cycle's data.							

Electric power consumptions	Unit	Value
Thermostat-off mode [P <sub>TO</sub> ]	kW	0.019
Standby mode [P <sub>SB</sub> ]	kW	0.014
Crankcase heater [P <sub>CK</sub> ]	kW	0.043
Off mode [P <sub>OFF</sub> ]	kW	0.014

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

3.Calculation/conclusion for SCOP:						
Tdesignh(°C):	-10	Tbiv(°C) :	-7			
Pdesignh(kW):	7.654	TOL(°C) :	-10			
Test result A, B, C, D, E, F conditions:						
Condition	Part load	Measured capacity	Measured COP	Cdh	CR	COP at part load
E	7.654	6.456	2.67	0.90	1.00	2.67
F	6.771	6.771	2.91	0.90	1.00	2.91
A	6.771	6.771	2.91	0.90	1.00	2.91
B	4.121	4.302	4.95	0.90	0.96	4.95
C	2.650	4.309	6.48	0.90	0.61	6.10
D	1.178	4.940	8.47	0.90	0.24	6.42
CR: part load divided by capacity;						

Conclusions:	Unit	Value
SCOPon:	kWh/kWh	4.81
SCOP:	kWh/kWh	4.79
QH:	kWh/year	15813
QHE:	kWh/year	3299
$\eta_{s,h}$	%	188.7
Seasonal space heating energy efficiency classes: (According (EU) No 811/2013 Table 2)	--	A+++

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

<b>Table 4.</b>	<b>Heating mode (Medium temperature application):</b>							<b>P</b>	
<b>Model</b>	CGK040V4P								
<b>Product type</b>	Air to Water	<b>Heating season</b>	<input checked="" type="checkbox"/>	Average	<input type="checkbox"/>	Warmer	<input type="checkbox"/>	Colder	
<b>1. Test conditions:</b>									
Condition	Part Load Ratio in %		Outdoor heat exchanger		Indoor heat exchanger				
	Formula	Average climates	Inlet dry (wet) bulb temperature (°C)		Inlet/outlet water temperatures (°C)				
A	$(-7-16)/(T_{designh-16})$	88	-7(-8)		a / 52				
B	$(+2-16)/(T_{designh-16})$	54	2(1)		a / 42				
C	$(+7-16)/(T_{designh-16})$	35	7(6)		a / 36				
D	$(+12-16)/(T_{designh-16})$	15	12(11)		a / 30				
E	$(TOL-16)/(T_{designh-16})$		TOL		a / 55.3				
F	$(T_{bivalent-16})/(T_{designh-16})$		T <sub>biv</sub>		a / 52				
G	$(-15-16)/(T_{designh-16})$	N/A	-15		N/A				
Remark: a) With the water flow rate as determined at the standard rating conditions given in EN14511-2 at 47/55 conditions, the capacity is 7.205kW, the power is 2.321kW, the COP is 3.10kW/kW.									
<b>2. Tested data/correction data(Average):</b>									
General test conditions/ Part-Load	Unit	A(-7)/W52 (88%)	A2/W42 (54%)	A7/W36 (35%)	A12/W30 (15%)	A(-10)/ W55.3 (100%)	A(-7)/W52 (88%)		
	--	A	B	C	D	E	F		
Data collection period	hh: min:sec	3:00:00	1:10:00	1:10:00	1:10:00	3:00:00	3:00:00		
The heat pump defrosts	--	Yes	No	No	No	Yes	Yes		
<b>Electrical Properties</b>									
Voltage	V	230.0	230.4	230.3	230.4	229.9	230.0		
Current input of the unit	A	12.29	4.94	3.89	3.45	12.96	12.29		
Power input of the unit	kW	2.797	1.082	0.837	0.733	2.950	2.797		
Compressor frequency	Hz	80	35	30	30	83	80		

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

Test conditions User Side							
Water flow	m <sup>3</sup> /h	0.78	0.78	0.78	0.78	0.78	0.78
Inlet Water temperature	°C	44.48	37.40	33.24	28.75	47.79	44.48
Outlet Water temperature	°C	51.56*	41.88	37.80	34.02	54.69*	51.56*
Test conditions Source Side							
Barometric pressure	kPa	99.85	99.85	99.85	99.80	99.75	99.85
Air inlet temperature, DB	°C	-7.00	2.00	7.00	12.00	-10.00	-7.00
Air inlet temperature, WB	°C	-8.05	1.00	6.00	11.00	-10.97	-8.05
Summary of the results							
Total heating capacity	kW	6.330	4.026	4.098	4.749	6.170	6.330
Effective power input	kW	2.794	1.079	0.834	0.730	2.947	2.794
Coefficient of performance (COP)	kW/kW	2.27	3.73	4.91	6.51	2.09	2.27
Remark: * In part condition, outlet temperature data is recorded by the full average complete cycle's data.							

Electric power consumptions	Unit	Value
Thermostat-off mode [P <sub>TO</sub> ]	kW	0.019
Standby mode [P <sub>SB</sub> ]	kW	0.014
Crankcase heater [P <sub>CK</sub> ]	kW	0.043
Off mode [P <sub>OFF</sub> ]	kW	0.014

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

3.Calculation/conclusion for SCOP:						
Tdesignh(°C):	-10	Tbiv(°C) :	-7			
Pdesignh(kW):	7.156	TOL(°C) :	-10			
Test result A, B, C, D, E, F conditions:						
Condition	Part load	Measured capacity	Measured COP	Cdh	CR	COP at part load
E	7.156	6.170	2.09	0.90	1.00	2.09
F	6.330	6.330	2.27	0.90	1.00	2.27
A	6.330	6.330	2.27	0.90	1.00	2.27
B	3.853	4.026	3.73	0.90	0.96	3.73
C	2.477	4.098	4.91	0.90	0.60	4.61
D	1.101	4.749	6.51	0.90	0.23	4.89
CR: part load divided by capacity;						

Conclusions:	Unit	Value
SCOPon:	kWh/kWh	3.67
SCOP:	kWh/kWh	3.66
QH:	kWh/year	14784
QHE:	kWh/year	4045
$\eta_{s,h}$	%	143.2
Seasonal space heating energy efficiency classes: (According (EU) No 811/2013 Table 1)	--	A++

Doc No.: ITC-TTW0902.02E -- Rev.13



Appendix I Test results

<b>Table 5.</b>	<b>Heating mode (Low temperature application):</b>							<b>P</b>
<b>Model</b>	CGK050V4P							
<b>Product type</b>	Air to Water	<b>Heating season</b>	<input checked="" type="checkbox"/>	Average	<input type="checkbox"/>	Warmer	<input type="checkbox"/>	Colder
<b>1. Test conditions:</b>								
Condition	Part Load Ratio in %		Outdoor heat exchanger		Indoor heat exchanger			
	Formula	Average climates	Inlet dry (wet) bulb temperature (°C)		Inlet/outlet water temperatures (°C)			
A	$(-7-16)/(T_{designh-16})$	88	-7(-8)		a / 34			
B	$(+2-16)/(T_{designh-16})$	54	2(1)		a / 30			
C	$(+7-16)/(T_{designh-16})$	35	7(6)		a / 27			
D	$(+12-16)/(T_{designh-16})$	15	12(11)		a / 24			
E	$(TOL-16)/(T_{designh-16})$		TOL		a / 35.3			
F	$(T_{bivalent-16})/(T_{designh-16})$		T <sub>biv</sub>		a / 34			
G	$(-15-16)/(T_{designh-16})$	N/A	-15		N/A			
Remark: a) With the water flow rate as determined at the standard rating conditions given in EN14511-2 at 30/35 conditions, the capacity is 10.657kW, the power is 2.342kW, the COP is 4.55kW/kW.								
<b>2. Tested data/correction data(Average):</b>								
General test conditions/ Part-Load	Unit	A(-7)/W34 (88%)	A2/W30 (54%)	A7/W27 (35%)	A12/W24 (15%)	A(-10)/ W35.3 (100%)	A(-7)/W34 (88%)	
	--	A	B	C	D	E	F	
Data collection period	hh: min:sec	3:00:00	1:10:00	1:10:00	1:10:00	3:00:00	3:00:00	
The heat pump defrosts	--	Yes	No	No	No	Yes	Yes	
<b>Electrical Properties</b>								
Voltage	V	229.5	230.1	230.3	230.3	229.5	229.5	
Current input of the unit	A	14.90	5.45	4.26	3.82	17.15	14.90	
Power input of the unit	kW	3.389	1.200	0.919	0.817	3.902	3.389	
Compressor frequency	Hz	85	35	30	30	85	85	

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

Test conditions User Side							
Water flow	m³/h	1.82	1.82	1.82	1.82	1.82	1.82
Inlet Water temperature	°C	29.25	27.28	25.29	23.15	30.39	29.25
Outlet Water temperature	°C	33.63*	29.98	28.07	26.34	34.93*	33.63*
Test conditions Source Side							
Barometric pressure	kPa	101.02	101.01	101.01	101.02	101.01	101.02
Air inlet temperature, DB	°C	-6.95	2.00	7.00	12.00	-9.97	-6.95
Air inlet temperature, WB	°C	-7.90	1.00	6.01	10.99	-11.00	-7.90
Summary of the results							
Total heating capacity	kW	9.199	5.648	5.831	6.702	9.541	9.199
Effective power input	kW	3.366	1.176	0.895	0.793	3.879	3.366
Coefficient of performance (COP)	kW/kW	2.73	4.80	6.51	8.45	2.46	2.73
Remark: * In part condition, outlet temperature data is recorded by the full average complete cycle's data.							

Electric power consumptions	Unit	Value
Thermostat-off mode [P <sub>TO</sub> ]	kW	0.025
Standby mode [P <sub>SB</sub> ]	kW	0.015
Crankcase heater [P <sub>CK</sub> ]	kW	0.038
Off mode [P <sub>OFF</sub> ]	kW	0.015

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

3.Calculation/conclusion for SCOP:						
Tdesignh(°C):	-10	Tbiv(°C) :	-7			
Pdesignh(kW):	10.399	TOL(°C) :	-10			
Test result A, B, C, D, E, F conditions:						
Condition	Part load	Measured capacity	Measured COP	Cdh	CR	COP at part load
E	10.399	9.541	2.46	0.90	1.00	2.46
F	9.199	9.199	2.73	0.90	1.00	2.73
A	9.199	9.199	2.73	0.90	1.00	2.73
B	5.600	5.648	4.80	0.90	0.99	4.80
C	3.600	5.831	6.51	0.90	0.62	6.13
D	1.600	6.702	8.45	0.90	0.24	6.41
CR: part load divided by capacity;						

Conclusions:	Unit	Value
SCOPon:	kWh/kWh	4.70
SCOP:	kWh/kWh	4.69
QH:	kWh/year	21485
QHE:	kWh/year	4582
$\eta_{s,h}$	%	184.6
Seasonal space heating energy efficiency classes: (According (EU) No 811/2013 Table 2)	--	A+++

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

<b>Table 6.</b>	<b>Heating mode (Medium temperature application):</b>							<b>P</b>
<b>Model</b>	CGK050V4P							
<b>Product type</b>	Air to Water	<b>Heating season</b>	<input checked="" type="checkbox"/>	Average	<input type="checkbox"/>	Warmer	<input type="checkbox"/>	Colder
<b>1. Test conditions:</b>								
Condition	Part Load Ratio in %		Outdoor heat exchanger		Indoor heat exchanger			
	Formula	Average climates	Inlet dry (wet) bulb temperature (°C)		Inlet/outlet water temperatures (°C)			
A	$(-7-16)/(T_{designh-16})$	88	-7(-8)		a / 52			
B	$(+2-16)/(T_{designh-16})$	54	2(1)		a / 42			
C	$(+7-16)/(T_{designh-16})$	35	7(6)		a / 36			
D	$(+12-16)/(T_{designh-16})$	15	12(11)		a / 30			
E	$(TOL-16)/(T_{designh-16})$		TOL		a / 55.3			
F	$(T_{bivalent-16})/(T_{designh-16})$		T <sub>biv</sub>		a / 52			
G	$(-15-16)/(T_{designh-16})$	N/A	-15		N/A			
Remark: a) With the water flow rate as determined at the standard rating conditions given in EN14511-2 at 47/55 conditions, the capacity is 9.404kW, the power is 3.132kW, the COP is 3.00kW/kW.								
<b>2. Tested data/correction data(Average):</b>								
General test conditions/ Part-Load	Unit	A(-7)/W52 (88%)	A2/W42 (54%)	A7/W36 (35%)	A12/W30 (15%)	A(-10)/ W55.3 (100%)	A(-7)/W52 (88%)	
	--	A	B	C	D	E	F	
Data collection period	hh: min:sec	3:00:00	1:10:00	1:10:00	1:10:00	3:00:00	3:00:00	
The heat pump defrosts	--	Yes	No	No	No	Yes	Yes	
<b>Electrical Properties</b>								
Voltage	V	229.3	230.5	230.3	230.3	230.0	229.3	
Current input of the unit	A	15.78	6.56	5.10	4.58	19.38	15.78	
Power input of the unit	kW	3.590	1.466	1.119	0.996	4.423	3.590	
Compressor frequency	Hz	85	35	30	30	85	85	

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

Test conditions User Side							
Water flow	m <sup>3</sup> /h	1.04	1.04	1.04	1.04	1.04	1.04
Inlet Water temperature	°C	44.80	37.54	33.25	28.79	47.27	44.80
Outlet Water temperature	°C	51.64*	41.99	37.80	34.06	54.93*	51.64*
Test conditions Source Side							
Barometric pressure	kPa	99.85	99.85	99.85	99.80	99.75	99.85
Air inlet temperature, DB	°C	-6.97	2.01	7.27	12.00	-10.00	-6.97
Air inlet temperature, WB	°C	-8.09	1.03	6.02	10.99	-10.98	-8.09
Summary of the results							
Total heating capacity	kW	8.254	5.321	5.459	6.330	9.147	8.254
Effective power input	kW	3.586	1.462	1.115	0.992	4.419	3.586
Coefficient of performance (COP)	kW/kW	2.30	3.64	4.90	6.38	2.07	2.30
Remark: * In part condition, outlet temperature data is recorded by the full average complete cycle's data.							

Electric power consumptions	Unit	Value
Thermostat-off mode [P <sub>TO</sub> ]	kW	0.025
Standby mode [P <sub>SB</sub> ]	kW	0.015
Crankcase heater [P <sub>CK</sub> ]	kW	0.038
Off mode [P <sub>OFF</sub> ]	kW	0.015

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

3.Calculation/conclusion for SCOP:						
Tdesignh(°C):	-10	Tbiv(°C) :	-7			
Pdesignh(kW):	9.330	TOL(°C) :	-10			
Test result A, B, C, D, E, F conditions:						
Condition	Part load	Measured capacity	Measured COP	Cdh	CR	COP at part load
E	9.330	9.147	2.07	0.90	1.00	2.07
F	8.254	8.254	2.30	0.90	1.00	2.30
A	8.254	8.254	2.30	0.90	1.00	2.30
B	5.024	5.321	3.64	0.90	0.94	3.64
C	3.230	5.459	4.90	0.90	0.59	4.58
D	1.435	6.330	6.38	0.90	0.23	4.76
CR: part load divided by capacity;						

Conclusions:	Unit	Value
SCOPon:	kWh/kWh	3.63
SCOP:	kWh/kWh	3.62
QH:	kWh/year	19276
QHE:	kWh/year	5327
$\eta_{s,h}$	%	141.8
Seasonal space heating energy efficiency classes: (According (EU) No 811/2013 Table 1)	--	A++

Doc No.: ITC-TTW0902.02E -- Rev.13

Appendix I Test results

Table 7.	Heating mode (Low temperature application):							P
Model	CGK060V4P							
Product type	Air to Water	Heating season	<input checked="" type="checkbox"/>	Average	<input type="checkbox"/>	Warmer	<input type="checkbox"/>	Colder
<b>1. Test conditions:</b>								
Condition	Part Load Ratio in %		Outdoor heat exchanger		Indoor heat exchanger			
	Formula	Average climates	Inlet dry (wet) bulb temperature (°C)		Inlet/outlet water temperatures (°C)			
A	$(-7-16)/(T_{designh-16})$	88	-7(-8)		a / 34			
B	$(+2-16)/(T_{designh-16})$	54	2(1)		a / 30			
C	$(+7-16)/(T_{designh-16})$	35	7(6)		a / 27			
D	$(+12-16)/(T_{designh-16})$	15	12(11)		a / 24			
E	$(TOL-16)/(T_{designh-16})$		TOL		a / 35.3			
F	$(T_{bivalent-16})/(T_{designh-16})$		T <sub>biv</sub>		a / 34			
G	$(-15-16)/(T_{designh-16})$	N/A	-15		N/A			
Remark: a) With the water flow rate as determined at the standard rating conditions given in EN14511-2 at 30/35 conditions, the capacity is 12.636kW, the power is 2.688kW, the COP is 4.70kW/kW.								
<b>2. Tested data/correction data(Average):</b>								
General test conditions/ Part-Load	Unit	A(-7)/W34 (88%)	A2/W30 (54%)	A7/W27 (35%)	A12/W24 (15%)	A(-10)/W35.3 (100%)	A(-7)/W34 (88%)	
	--	A	B	C	D	E	F	
Data collection period	hh: min:sec	3:00:00	1:10:00	1:10:00	1:10:00	1:10:00	3:00:00	
The heat pump defrosts	--	Yes	No	No	No	No	Yes	
<b>Electrical Properties</b>								
Voltage	V	229.7	229.6	230.8	230.9	229.1	229.7	
Current input of the unit	A	17.61	6.19	4.73	4.24	20.14	17.61	
Power input of the unit	kW	4.015	1.372	1.033	0.919	4.575	4.015	
Compressor frequency	Hz	85	35	30	30	85	85	

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

Test conditions User Side							
Water flow	m³/h	2.20	2.20	2.20	2.20	2.20	2.20
Inlet Water temperature	°C	29.49	27.40	25.34	23.20	30.65	29.49
Outlet Water temperature	°C	33.72*	29.99	28.12	26.35	35.21	33.72*
Test conditions Source Side							
Barometric pressure	kPa	101.02	101.01	101.01	101.02	101.01	101.02
Air inlet temperature, DB	°C	-6.95	2.02	7.00	12.00	-10.00	-6.95
Air inlet temperature, WB	°C	-7.87	1.00	6.01	10.99	-11.08	-7.87
Summary of the results							
Total heating capacity	kW	10.765	6.594	7.070	8.021	11.560	10.765
Effective power input	kW	3.999	1.355	1.017	0.903	4.558	3.999
Coefficient of performance (COP)	kW/kW	2.69	4.87	6.95	8.89	2.54	2.69
Remark: * In part condition, outlet temperature data is recorded by the full average complete cycle's data.							

Electric power consumptions	Unit	Value
Thermostat-off mode [P <sub>TO</sub> ]	kW	0.026
Standby mode [P <sub>SB</sub> ]	kW	0.015
Crankcase heater [P <sub>CK</sub> ]	kW	0.038
Off mode [P <sub>OFF</sub> ]	kW	0.015

Doc No.: ITC-TTW0902.02E – Rev.13



Appendix I Test results

3.Calculation/conclusion for SCOP:						
Tdesignh(°C):	-10	Tbiv(°C) :	-7			
Pdesignh(kW):	12.169	TOL(°C) :	-10			
Test result A, B, C, D, E, F conditions:						
Condition	Part load	Measured capacity	Measured COP	Cdh	CR	COP at part load
E	12.169	11.560	2.54	0.90	1.00	2.54
F	10.765	10.765	2.69	0.90	1.00	2.69
A	10.765	10.765	2.69	0.90	1.00	2.69
B	6.552	6.594	4.87	0.90	0.99	4.87
C	4.212	7.070	6.95	0.90	0.60	6.51
D	1.872	8.021	8.89	0.90	0.23	6.69
CR: part load divided by capacity;						

Conclusions:	Unit	Value
SCOPon:	kWh/kWh	4.81
SCOP:	kWh/kWh	4.80
QH:	kWh/year	25140
QHE:	kWh/year	5240
$\eta_{s,h}$	%	188.9
Seasonal space heating energy efficiency classes: (According (EU) No 811/2013 Table 2)	--	A+++

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

<b>Table 8.</b>	<b>Heating mode (Medium temperature application):</b>							<b>P</b>	
<b>Model</b>	CGK060V4P								
<b>Product type</b>	Air to Water	<b>Heating season</b>	<input checked="" type="checkbox"/>	Average	<input type="checkbox"/>	Warmer	<input type="checkbox"/>	Colder	
<b>1. Test conditions:</b>									
Condition	Part Load Ratio in %		Outdoor heat exchanger		Indoor heat exchanger				
	Formula	Average climates	Inlet dry (wet) bulb temperature (°C)		Inlet/outlet water temperatures (°C)				
A	$(-7-16)/(T_{designh-16})$	88	-7(-8)		a / 52				
B	$(+2-16)/(T_{designh-16})$	54	2(1)		a / 42				
C	$(+7-16)/(T_{designh-16})$	35	7(6)		a / 36				
D	$(+12-16)/(T_{designh-16})$	15	12(11)		a / 30				
E	$(TOL-16)/(T_{designh-16})$		TOL		a / 55.3				
F	$(T_{bivalent-16})/(T_{designh-16})$		T <sub>biv</sub>		a / 52				
G	$(-15-16)/(T_{designh-16})$	N/A	-15		N/A				
Remark: a) With the water flow rate as determined at the standard rating conditions given in EN14511-2 at 47/55 conditions, the capacity is 11.465kW, the power is 3.690kW, the COP is 3.11kW/kW.									
<b>2. Tested data/correction data(Average):</b>									
General test conditions/ Part-Load	Unit	A(-7)/W52 (88%)	A2/W42 (54%)	A7/W36 (35%)	A12/W30 (15%)	A(-10)/ W55.3 (100%)	A(-7)/W52 (88%)		
	--	A	B	C	D	E	F		
Data collection period	hh: min:sec	3:00:00	1:10:00	1:10:00	1:10:00	3:00:00	3:00:00		
The heat pump defrosts	--	Yes	No	No	No	Yes	Yes		
<b>Electrical Properties</b>									
Voltage	V	229.3	230.4	230.7	230.8	229.3	229.3		
Current input of the unit	A	21.62	7.48	5.84	5.21	21.97	21.62		
Power input of the unit	kW	4.920	1.683	1.299	1.150	4.997	4.920		
Compressor frequency	Hz	85	35	30	30	85	85		

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

Test conditions User Side							
Water flow	m³/h	1.25	1.25	1.25	1.25	1.25	1.25
Inlet Water temperature	°C	44.42	37.51	33.25	28.69	47.30	44.42
Outlet Water temperature	°C	51.69*	41.94	37.81	33.93	54.36*	51.69*
Test conditions Source Side							
Barometric pressure	kPa	99.85	99.85	99.85	99.80	99.75	99.85
Air inlet temperature, DB	°C	-7.01	2.00	7.00	12.00	-9.97	-7.01
Air inlet temperature, WB	°C	-8.11	1.03	6.01	10.98	-10.96	-8.11
Summary of the results							
Total heating capacity	kW	10.430	6.366	6.583	7.570	10.125	10.430
Effective power input	kW	4.917	1.679	1.295	1.146	4.993	4.917
Coefficient of performance (COP)	kW/kW	2.12	3.79	5.08	6.60	2.03	2.12
Remark: * In part condition, outlet temperature data is recorded by the full average complete cycle's data.							

Electric power consumptions	Unit	Value
Thermostat-off mode [P <sub>TO</sub> ]	kW	0.026
Standby mode [P <sub>SB</sub> ]	kW	0.015
Crankcase heater [P <sub>CK</sub> ]	kW	0.038
Off mode [P <sub>OFF</sub> ]	kW	0.015

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

3.Calculation/conclusion for SCOP:						
Tdesignh(°C):	-10	Tbiv(°C) :	-7			
Pdesignh(kW):	11.791	TOL(°C) :	-10			
Test result A, B, C, D, E, F conditions:						
Condition	Part load	Measured capacity	Measured COP	Cdh	CR	COP at part load
E	11.791	10.125	2.03	0.90	1.00	2.03
F	10.430	10.430	2.12	0.90	1.00	2.12
A	10.430	10.430	2.12	0.90	1.00	2.12
B	6.349	6.366	3.79	0.90	1.00	3.79
C	4.081	6.583	5.08	0.90	0.62	4.79
D	1.814	7.570	6.60	0.90	0.24	5.01
CR: part load divided by capacity;						

Conclusions:	Unit	Value
SCOPon:	kWh/kWh	3.69
SCOP:	kWh/kWh	3.68
QH:	kWh/year	24360
QHE:	kWh/year	6612
$\eta_{s,h}$	%	144.4
Seasonal space heating energy efficiency classes: (According (EU) No 811/2013 Table 1)	--	A++

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

Table 9a.	Sound power level measurement (Low temperature application)		P
Model	CGK030V4P		
	Product type :	Air to Water	
	Outdoor heat exchanger, Air temperature DB/WB (°C):	7.0 / 6.0	
	Indoor heat exchanger, Water inlet/outlet temperature (°C):	30.0 / 35.0	
	Voltage (V):	230	
	Frequency (Hz):	50	
	Working condition class :	Class A	
	Acoustical environment :	Hemi-anechoic room	
	Windshield type :	Sponge	
	Measured position amount :	14	
	Water flow (m³/h):	1.32	
Measured quantity	L <sub>WA,indoors</sub> (dB(A))	L <sub>WA,outdoors</sub> (dB(A))	Remark
Sound pressure level $\bar{L}_{p(ST)}$ ****	--	47	--
Measurement distance d *	--	1.0m	--
Sound power level L <sub>WA</sub> ****	--	61	--
Setting of controls: according to user manual. Duct connection:-- Rounding to: *) 1 decimal places; **) 2 decimal places; ***) 3 decimal places; ****) nearest integer Fan speed: 600 r/min, compressor frequency: 58Hz.			

Appendix I Test results

Table 9b.	Sound power level measurement (Medium temperature application)	P	
Model	CGK030V4P		
	Product type :	Air to Water	
	Outdoor heat exchanger, Air temperature DB/WB (°C):	7.0 / 6.0	
	Indoor heat exchanger, Water inlet/outlet temperature (°C):	47.0 / 55.0	
	Voltage (V):	230	
	Frequency (Hz):	50	
	Working condition class :	Class A	
	Acoustical environment :	Hemi-anechoic room	
	Windshield type :	Sponge	
	Measured position amount :	14	
	Water flow (m³/h):	0.75	
Measured quantity	L <sub>WA,indoors</sub> (dB(A))	L <sub>WA,outdoors</sub> (dB(A))	Remark
Sound pressure level $\bar{L}_{p(ST)}$ ****	--	46	--
Measurement distance d *	--	1.0m	--
Sound power level L <sub>WA</sub> ****	--	60	--
Setting of controls: according to user manual.			
Duct connection:--			
Rounding to: *) 1 decimal places; **) 2 decimal places; ***) 3 decimal places; ****) nearest integer			
Fan speed: 557 r/min, compressor frequency: 58Hz.			

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

Table 10a.	Sound power level measurement (Low temperature application)		P
Model	CGK040V4P		
	Product type :	Air to Water	
	Outdoor heat exchanger, Air temperature DB/WB (°C):	7.0 / 6.0	
	Indoor heat exchanger, Water inlet/outlet temperature (°C):	30.0 / 35.0	
	Voltage (V):	230	
	Frequency (Hz):	50	
	Working condition class :	Class A	
	Acoustical environment :	Hemi-anechoic room	
	Windshield type :	Sponge	
	Measured position amount :	14	
	Water flow (m³/h):	1.40	
Measured quantity	L <sub>WA,indoors</sub> (dB(A))	L <sub>WA,outdoors</sub> (dB(A))	Remark
Sound pressure level $\bar{L}_{p(ST)}$ ****	--	46	--
Measurement distance d *	--	1.0m	--
Sound power level L <sub>WA</sub> ****	--	60	--
Setting of controls: according to user manual. Duct connection:-- Rounding to: *) 1 decimal places; **) 2 decimal places; ***) 3 decimal places; ****) nearest integer Fan speed: 590 r/min, compressor frequency: 60Hz.			

Appendix I Test results

Table 10b. Sound power level measurement (Medium temperature application)		P	
Model	CGK040V4P		
	Product type :	Air to Water	
	Outdoor heat exchanger, Air temperature DB/WB (°C):	7.0 / 6.0	
	Indoor heat exchanger, Water inlet/outlet temperature (°C):	47.0 / 55.0	
	Voltage (V):	230	
	Frequency (Hz):	50	
	Working condition class :	Class A	
	Acoustical environment :	Hemi-anechoic room	
	Windshield type :	Sponge	
	Measured position amount :	14	
	Water flow (m³/h):	0.78	
Measured quantity	L <sub>WA,indoors</sub> (dB(A))	L <sub>WA,outdoors</sub> (dB(A))	Remark
Sound pressure level $\bar{L}_{p(ST)}$ ****	--	45	--
Measurement distance d *	--	1.0m	--
Sound power level L <sub>WA</sub> ****	--	59	--
Setting of controls: according to user manual.			
Duct connection:--			
Rounding to: *) 1 decimal places; **) 2 decimal places; ***) 3 decimal places; ****) nearest integer			
Fan speed: 550 r/min, compressor frequency: 60Hz.			

Doc No.: ITC-TTW0902.02E – Rev.13



Appendix I Test results

Table 11a.	Sound power level measurement (Low temperature application)		P
Model	CGK050V4P		
	Product type :	Air to Water	
	Outdoor heat exchanger, Air temperature DB/WB (°C):	7.0 / 6.0	
	Indoor heat exchanger, Water inlet/outlet temperature (°C):	30.0 / 35.0	
	Voltage (V):	230	
	Frequency (Hz):	50	
	Working condition class :	Class A	
	Acoustical environment :	Hemi-anechoic room	
	Windshield type :	Sponge	
	Measured position amount :	14	
	Water flow (m³/h):	1.82	
Measured quantity	L <sub>WA,indoors</sub> (dB(A))	L <sub>WA,outdoors</sub> (dB(A))	Remark
Sound pressure level $\bar{L}_{p(ST)}$ ****	--	45	--
Measurement distance d *	--	1.0m	--
Sound power level L <sub>WA</sub> ****	--	60	--
Setting of controls: according to user manual.			
Duct connection:--			
Rounding to: *) 1 decimal places; **) 2 decimal places; ***) 3 decimal places; ****) nearest integer			
Fan speed: 490 r/min, compressor frequency: 60Hz.			

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

Table 11b. Sound power level measurement (Medium temperature application)		P	
Model	CGK050V4P		
Product type :			Air to Water
Outdoor heat exchanger, Air temperature DB/WB (°C):			7.0 / 6.0
Indoor heat exchanger, Water inlet/outlet temperature (°C):			47.0 / 55.0
Voltage (V):			230
Frequency (Hz):			50
Working condition class :			Class A
Acoustical environment :			Hemi-anechoic room
Windshield type :			Sponge
Measured position amount :			14
Water flow (m³/h):			1.04
Measured quantity	L <sub>WA,indoors</sub> (dB(A))	L <sub>WA,outdoors</sub> (dB(A))	Remark
Sound pressure level $\bar{L}_{p(ST)}$ ****	--	47	--
Measurement distance d *	--	1.0m	--
Sound power level L <sub>WA</sub> ****	--	62	--
Setting of controls: according to user manual.			
Duct connection:--			
Rounding to: *) 1 decimal places; **) 2 decimal places; ***) 3 decimal places; ****) nearest integer			
Fan speed: 470 r/min, compressor frequency: 60Hz.			

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

Table 12a.	Sound power level measurement (Low temperature application)		P
Model	CGK060V4P		
Product type :			Air to Water
Outdoor heat exchanger, Air temperature DB/WB (°C):			7.0 / 6.0
Indoor heat exchanger, Water inlet/outlet temperature (°C):			30.0 / 35.0
Voltage (V):			230
Frequency (Hz):			50
Working condition class :			Class A
Acoustical environment :			Hemi-anechoic room
Windshield type :			Sponge
Measured position amount :			14
Water flow (m³/h):			2.20
Measured quantity	L <sub>WA,indoors</sub> (dB(A))	L <sub>WA,outdoors</sub> (dB(A))	Remark
Sound pressure level $\bar{L}_{p(ST)}$ ****	--	48	--
Measurement distance d *	--	1.0m	--
Sound power level L <sub>WA</sub> ****	--	63	--
Setting of controls: according to user manual. Duct connection:-- Rounding to: *) 1 decimal places; **) 2 decimal places; ***) 3 decimal places; ****) nearest integer Fan speed: 550 r/min, compressor frequency: 60Hz.			

Appendix I Test results

Table 12b. Sound power level measurement (Medium temperature application)		P	
Model	CGK060V4P		
	Product type :	Air to Water	
	Outdoor heat exchanger, Air temperature DB/WB (°C):	7.0 / 6.0	
	Indoor heat exchanger, Water inlet/outlet temperature (°C):	47.0 / 55.0	
	Voltage (V):	230	
	Frequency (Hz):	50	
	Working condition class :	Class A	
	Acoustical environment :	Hemi-anechoic room	
	Windshield type :	Sponge	
	Measured position amount :	14	
	Water flow (m³/h):	1.25	
Measured quantity	L <sub>WA,indoors</sub> (dB(A))	L <sub>WA,outdoors</sub> (dB(A))	Remark
Sound pressure level $\bar{L}_{p(ST)}$ ****	--	48	--
Measurement distance d *	--	1.0m	--
Sound power level L <sub>WA</sub> ****	--	63	--
Setting of controls: according to user manual.			
Duct connection:--			
Rounding to: *) 1 decimal places; **) 2 decimal places; ***) 3 decimal places; ****) nearest integer			
Fan speed: 530 r/min, compressor frequency: 60Hz.			

Doc No.: ITC-TTW0902.02E – Rev.13

**Appendix I Test results**

<b>Table 13.</b>	<b>Clause 4 of EN 14511-4:2022</b>	<b>P</b>
<b>Model:</b>	<b>CGK030V4P</b>	
<b>TEST 1</b>	<b>STARTING TEST (§4.2.1.2 Table 3)</b>	
Requirement: The "lower" starting operating conditions declared by the manufacturer for the heating mode- i.e. T <sub>air</sub> = -25.04 °C, T in water = 10.08 °C, Flow rate 0.68 m <sup>3</sup> /h have been set and obtained. At those conditions, the machine was switched on.		
Observation/ Evaluation: It started without any problem and worked for 30 minutes without showing any warning or alarm. During the test the machine operated in auto mode. No damage was recorded on the machine during and after the test.		
Test Response: Pass		
<b>TEST 2</b>	<b>OPERATING TEST (§4.2.1.2 Table 3)</b>	
Requirement: From the machine "lower" starting conditions - i.e. - the machine was brought to the lower operating conditions declared by the manufacturer for the heating mode- i.e. T <sub>air</sub> = -24.96 °C, T in water = 51.95 °C, Flow rate 0.67 m <sup>3</sup> /h. Once these conditions were obtained, the machine was let operate for over 1 hour in auto mode.		
Observation/ Evaluation: During the test, no warning or alarm were showed. No damage was recorded on the machine during and after the test.		
Test Response: Pass		
<b>TEST 3</b>	<b>SHUTTING OFF WATER FLOW (§ 4.5)</b>	
Requirement: The water flow rate was shutted off through manual and automatic valves of the test rig. The machine switched off and only the flow switch Protection appeared on the user interface of indoor unit.		
Observation/ Evaluation: Perform error reset operation, once the water flow rate was restored, the machine restarted automatically and worked for 30 minutes normally. No damage was recorded on the machine during and after the test.		
Test Response: Pass		
<b>TEST 4</b>	<b>SHUTTING OFF AIR FLOW (§ 4.5)</b>	
Requirement: The air flow rate was shutted off through a plastic sheet and a panel. The machine never turned off. It continued to operate with continuous frosting and defrosting cycles. After more than half an hour, the air flow rate was restored and the machine started to operate normally.		
Observation/ Evaluation: During the test, no warning or alarm were showed. No damage was recorded on the machine during and after the test.		
Test Response: Pass		
<b>TEST 5</b>	<b>COMPLETE POWER SUPPLY FAILURE (§ 4.6)</b>	
Requirement: The power supply was cut off for about 5 seconds.		
Observation/ Evaluation: The unit restarted automatically within about 3 minutes after the power supply was reactivated.		
Test Response: Pass		

Doc No.: ITC-TTW0902.02E – Rev.13

**Appendix I Test results**

<b>Table 14.</b>	<b>Clause 4 of EN 14511-4:2022</b>	<b>P</b>
<b>Model:</b>	<b>CGK040V4P</b>	
<b>TEST 1</b>	<b>STARTING TEST (§4.2.1.2 Table 3)</b>	
Requirement: The "lower" starting operating conditions declared by the manufacturer for the heating mode- i.e. T <sub>air</sub> = -24.99 °C, T in water = 9.01 °C, Flow rate 0.70 m <sup>3</sup> /h have been set and obtained. At those conditions, the machine was switched on.		
Observation/ Evaluation: It started without any problem and worked for 30 minutes without showing any warning or alarm. During the test the machine operated in auto mode. No damage was recorded on the machine during and after the test.		
Test Response: Pass		
<b>TEST 2</b>	<b>OPERATING TEST (§4.2.1.2 Table 3)</b>	
Requirement: From the machine "lower" starting conditions - i.e. - the machine was brought to the lower operating conditions declared by the manufacturer for the heating mode- i.e. T <sub>air</sub> = -25.00 °C, T in water = 50.71 °C, Flow rate 0.70 m <sup>3</sup> /h. Once these conditions were obtained, the machine was let operate for over 1 hour in auto mode.		
Observation/ Evaluation: During the test, no warning or alarm were showed. No damage was recorded on the machine during and after the test.		
Test Response: Pass		
<b>TEST 3</b>	<b>SHUTTING OFF WATER FLOW (§ 4.5)</b>	
Requirement: The water flow rate was shutted off through manual and automatic valves of the test rig. The machine switched off and only the flow switch Protection appeared on the user interface of indoor unit.		
Observation/ Evaluation: Perform error reset operation, once the water flow rate was restored, the machine restarted automatically and worked for 30 minutes normally. No damage was recorded on the machine during and after the test.		
Test Response: Pass		
<b>TEST 4</b>	<b>SHUTTING OFF AIR FLOW (§ 4.5)</b>	
Requirement: The air flow rate was shutted off through a plastic sheet and a panel. The machine never turned off. It continued to operate with continuous frosting and defrosting cycles. After more than half an hour, the air flow rate was restored and the machine started to operate normally.		
Observation/ Evaluation: During the test, no warning or alarm were showed. No damage was recorded on the machine during and after the test.		
Test Response: Pass		
<b>TEST 5</b>	<b>COMPLETE POWER SUPPLY FAILURE (§ 4.6)</b>	
Requirement: The power supply was cut off for about 5 seconds.		
Observation/ Evaluation: The unit restarted automatically within about 3 minutes after the power supply was reactivated.		
Test Response: Pass		

Doc No.: ITC-TTW0902.02E – Rev.13

**Appendix I Test results**

<b>Table 15.</b>	<b>Clause 4 of EN 14511-4:2022</b>	<b>P</b>
<b>Model:</b>	<b>CGK050V4P</b>	
<b>TEST 1</b>	<b>STARTING TEST (§4.2.1.2 Table 3)</b>	
Requirement: The "lower" starting operating conditions declared by the manufacturer for the heating mode- i.e. Tair= -25.03 °C, T in water = 9.17 °C, Flow rate 0.94 m³/h have been set and obtained. At those conditions, the machine was switched on.		
Observation/ Evaluation: It started without any problem and worked for 30 minutes without showing any warning or alarm. During the test the machine operated in auto mode. No damage was recorded on the machine during and after the test.		
Test Response: Pass		

<b>TEST 2</b>	<b>OPERATING TEST (§4.2.1.2 Table 3)</b>	
Requirement: From the machine "lower" starting conditions - i.e. - the machine was brought to the lower operating conditions declared by the manufacturer for the heating mode- i.e. Tair= -25.01 °C, T in water = 50.75 °C, Flow rate 0.94 m³/h. Once these conditions were obtained, the machine was let operate for over 1 hour in auto mode.		
Observation/ Evaluation: During the test, no warning or alarm were showed. No damage was recorded on the machine during and after the test.		
Test Response: Pass		

<b>TEST 3</b>	<b>SHUTTING OFF WATER FLOW (§ 4.5)</b>	
Requirement: The water flow rate was shutted off through manual and automatic valves of the test rig. The machine switched off and only the flow switch Protection appeared on the user interface of indoor unit.		
Observation/ Evaluation: Perform error reset operation, once the water flow rate was restored, the machine restarted automatically and worked for 30 minutes normally. No damage was recorded on the machine during and after the test.		
Test Response: Pass		

<b>TEST 4</b>	<b>SHUTTING OFF AIR FLOW (§ 4.5)</b>	
Requirement: The air flow rate was shutted off through a plastic sheet and a panel. The machine never turned off. It continued to operate with continuous frosting and defrosting cycles. After more than half an hour, the air flow rate was restored and the machine started to operate normally.		
Observation/ Evaluation: During the test, no warning or alarm were showed. No damage was recorded on the machine during and after the test.		
Test Response: Pass		

<b>TEST 5</b>	<b>COMPLETE POWER SUPPLY FAILURE (§ 4.6)</b>	
Requirement: The power supply was cut off for about 5 seconds.		
Observation/ Evaluation: The unit restarted automatically within about 3 minutes after the power supply was reactivated.		
Test Response: Pass		

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix I Test results

<b>Table 16.</b>	<b>Clause 4 of EN 14511-4:2022</b>	<b>P</b>
<b>Model:</b>	<b>CGK060V4P</b>	
<b>TEST 1</b>	<b>STARTING TEST (§4.2.1.2 Table 3)</b>	
Requirement: The "lower" starting operating conditions declared by the manufacturer for the heating mode- i.e. T <sub>air</sub> = -25.00 °C, T in water = 8.45 °C, Flow rate 1.12 m <sup>3</sup> /h have been set and obtained. At those conditions, the machine was switched on.		
Observation/ Evaluation: It started without any problem and worked for 30 minutes without showing any warning or alarm. During the test the machine operated in auto mode. No damage was recorded on the machine during and after the test.		
Test Response: Pass		
<b>TEST 2</b>	<b>OPERATING TEST (§4.2.1.2 Table 3)</b>	
Requirement: From the machine "lower" starting conditions - i.e. - the machine was brought to the lower operating conditions declared by the manufacturer for the heating mode- i.e. T <sub>air</sub> = -25.00 °C, T in water = 50.88 °C, Flow rate 1.12 m <sup>3</sup> /h. Once these conditions were obtained, the machine was let operate for over 1 hour in auto mode.		
Observation/ Evaluation: During the test, no warning or alarm were showed. No damage was recorded on the machine during and after the test.		
Test Response: Pass		
<b>TEST 3</b>	<b>SHUTTING OFF WATER FLOW (§ 4.5)</b>	
Requirement: The water flow rate was shutted off through manual and automatic valves of the test rig. The machine switched off and only the flow switch Protection appeared on the user interface of indoor unit.		
Observation/ Evaluation: Perform error reset operation, once the water flow rate was restored, the machine restarted automatically and worked for 30 minutes normally. No damage was recorded on the machine during and after the test.		
Test Response: Pass		
<b>TEST 4</b>	<b>SHUTTING OFF AIR FLOW (§ 4.5)</b>	
Requirement: The air flow rate was shutted off through a plastic sheet and a panel. The machine never turned off. It continued to operate with continuous frosting and defrosting cycles. After more than half an hour, the air flow rate was restored and the machine started to operate normally.		
Observation/ Evaluation: During the test, no warning or alarm were showed. No damage was recorded on the machine during and after the test.		
Test Response: Pass		
<b>TEST 5</b>	<b>COMPLETE POWER SUPPLY FAILURE (§ 4.6)</b>	
Requirement: The power supply was cut off for about 5 seconds.		
Observation/ Evaluation: The unit restarted automatically within about 3 minutes after the power supply was reactivated.		
Test Response: Pass		





Doc No.: ITC-TTW0902.02E – Rev.13



Appendix II Marking plate

Nameplate

Model: CGK030V4P




  	
DC Inverter Air Source Heat Pumps	
Model	CGK030V4P
Power Supply	220-240V~/50Hz
*Heating Capacity Min./Max.	3.77/8.2kW
*Heating Input Power Min./Max.	0.75/2.08kW
*Heating COP Min./Max.	3.95/5.02W/W
Cooling Capacity Min./Max.	3.13/6.8kW
Cooling Input Power Min./Max.	0.95/2.72kW
Rated Input Power/Current	4.36kW/20.86A
Max. Water Outlet Temperature	75°C
Max. Water Pump Flow	4m <sup>3</sup> /h
Max. Water Pump Head	9m
Rated Water Flow	1.5m <sup>3</sup> /h
Refrigerant/Weight 	R290/0.8kg
Low/High side operation pressure	0.85/3.2MPa
Low/High maximum allowable pressure	1.8/3.2MPa
Max Water Pressure	1.0MPa
Shock Proof Grade	I
Water Proof Level	IPX4
Water Pressure Drop	20kPa
Water Pipe Connection	1 inch
Net Weight	112kg
Date/NO.	See bar code
<b>System CO2 equivalent charge weight: 0.0024 ton</b>	
*Heating working condition: Dry bulb temperature 7°C, Wet bulb temperature 6°C Inlet water temperature 30°C, Outlet water temperature 35°C	
Guangzhou Sprsun New Energy Technology Development Co., Ltd No. 15 Tangxi Road, Yinsha Industrial Park, Xintang, Zengcheng Guangzhou, China	

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix II Marking plate

Nameplate

Model: CGK040V4P




<b>SPRSUN</b>  	
<b>DC Inverter Air Source Heat Pumps</b>	
Model	CGK040V4P
Power Supply	220-240V~/50Hz
*Heating Capacity Min./Max.	4.42/9.6kW
*Heating Input Power Min./Max.	0.92/2.53kW
*Heating COP Min./Max.	3.8/4.83W/W
Cooling Capacity Min./Max.	3.5/7.6kW
Cooling Input Power Min./Max.	1.1/3.04kW
Rated Input Power/Current	5.05kW/24.18A
Max. Water Outlet Temperature	75°C
Max. Water Pump Flow	4m <sup>3</sup> /h
Max. Water Pump Head	9m
Rated Water Flow	1.9m <sup>3</sup> /h
Refrigerant/Weight 	R290/1.0kg
Low/High side operation pressure	0.85/3.2MPa
Low/High maximum allowable pressure	1.8/3.2MPa
Max Water Pressure	1.0MPa
Shock Proof Grade	I
Water Proof Level	IPX4
Water Pressure Drop	21kPa
Water Pipe Connection	1 inch
Net Weight	125kg
Date/NO.	See bar code
<b>System CO2 equivalent charge weight: 0.003 ton</b>	
*Heating working condition: Dry bulb temperature 7°C, Wet bulb temperature 6°C Inlet water temperature 30°C, Outlet water temperature 35	
Guangzhou Sprsun New Energy Technology Development Co., Ltd No. 15 Tangxi Road, Yinsha Industrial Park, Xintang, Zengcheng Guangzhou, China	

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix II Marking plate

Nameplate

Model: CGK050V4P





SPRSUN  	
DC Inverter Air Source Heat Pumps	
Model	CGK050V4P
Power Supply	220-240V~/50Hz
*Heating Capacity Min./Max.	5.93/12.9kW
*Heating Input Power Min./Max.	1.24/3.51kW
*Heating COP Min./Max.	3.68/4.78W/W
Cooling Capacity Min./Max.	4.88/10.6kW
Cooling Input Power Min./Max.	1.55/4.42kW
Rated Input Power/Current	6.8kW/32.54A
Max. Water Outlet Temperature	75°C
Max. Water Pump Flow	6.2m <sup>3</sup> /h
Max. Water Pump Head	10.5m
Rated Water Flow	2.6m <sup>3</sup> /h
Refrigerant/Weight 	R290/1.2kg
Low/High side operation pressure	0.85/3.2MPa
High maximum allowable pressure	3.2MPa
Max Water Pressure	1.0MPa
Shock Proof Grade	I
Water Proof Level	IPX4
Water Pressure Drop	23kPa
Water Pipe Connection	1 inch
Net Weight	145kg
Date/NO.	See bar code
System CO2 equivalent charge weight: 0.0036 ton	
*Heating working condition: Dry bulb temperature 7°C, Wet bulb temperature 6°C Inlet water temperature 30°C, Outlet water temperature 35°C	
Guangzhou Sprsun New Energy Technology Development Co., Ltd No. 15 Tangxi Road, Yinsha Industrial Park, Xintang, Zengcheng Guangzhou, China	

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix II Marking plate


Nameplate

Model: CGK060V4P

  	
DC Inverter Air Source Heat Pumps	
Model	CGK060V4P
Power Supply	220-240V~/50Hz
*Heating Capacity Min./Max.	6.9/15kW
*Heating Input Power Min./Max.	1.33/3.92kW
*Heating COP Min./Max.	3.83/5.17W/W
Cooling Capacity Min./Max.	5.7/12.4kW
Cooling Input Power Min./Max.	1.6/5.17kW
Rated Input Power/Current	7.83kW/37.5A
Max. Water Outlet Temperature	75°C
Max. Water Pump Flow	6.2m <sup>3</sup> /h
Max. Water Pump Head	10.5m
Rated Water Flow	3.1m <sup>3</sup> /h
Refrigerant/Weight 	R290/1.8kg
Low/High side operation pressure	0.85/3.2MPa
High maximum allowable pressure	3.2MPa
Max Water Pressure	1.0MPa
Shock Proof Grade	I
Water Proof Level	IPX4
Water Pressure Drop	25kPa
Water Pipe Connection	1 inch
Net Weight	147kg
Date/NO.	See bar code
<b>System CO2 equivalent charge weight: 0.0054 ton</b>	
*Heating working condition: Dry bulb temperature 7°C, Wet bulb temperature 6°C Inlet water temperature 30°C, Outlet water temperature 35°C	
Guangzhou Sprsun New Energy Technology Development Co., Ltd No. 15 Tangxi Road, Yinsha Industrial Park, Xintang, Zengcheng Guangzhou, China	

Doc No.: ITC-TTW0902.02E – Rev.13


Appendix III photo documentation

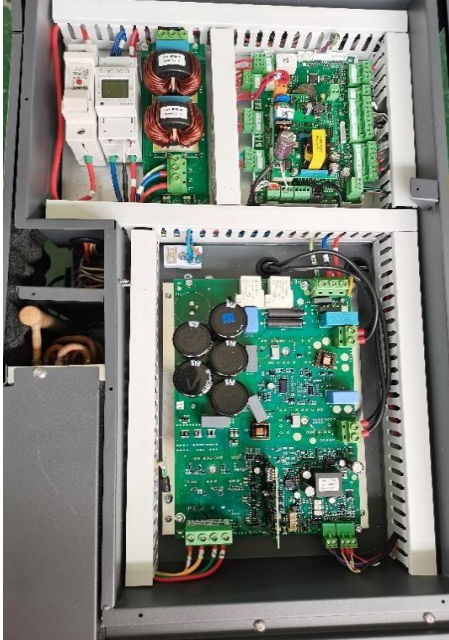
Details of:	Overall view for CGK030V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Details of:	Compressor for CGK030V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Doc No.: ITC-TTW0902.02E – Rev.13


Appendix III photo documentation


Details of:	Fan Motor for CGK030V4P
<p><b>View:</b></p> <p><input type="checkbox"/> General</p> <p><input type="checkbox"/> Front</p> <p><input type="checkbox"/> Rear</p> <p><input type="checkbox"/> Right</p> <p><input type="checkbox"/> Left</p> <p><input type="checkbox"/> Top</p> <p><input type="checkbox"/> Bottom</p>	 <p>The image shows a label for a WOLONG Air Conditioner BLDC Motor. The label includes the following information:         <ul style="list-style-type: none"> <li>Model: ZWB278D04A(1821300) DC310V</li> <li>Power: 102W 8P 920r/min</li> <li>IP Rating: IP24 E级</li> <li>Company: 卧龙电气驱动集团股份有限公司 (WOLONG ELECTRIC GROUP CO., LTD.)</li> <li>Wiring Diagram: A diagram of a motor with five terminals: Blue (BU) FG, Yellow (YE) Vsp, White (WH) Vcc, Black (BK) GND, and Red (RD) Vm.</li> <li>Compliance: Q.C.PASS RoHS</li> <li>QR Code: 1821300061A206658</li> <li>Serial Number: ADV0093</li> </ul> </p>

Details of:	Main Control Board for CGK030V4P
<p><b>View:</b></p> <p><input type="checkbox"/> General</p> <p><input type="checkbox"/> Front</p> <p><input type="checkbox"/> Rear</p> <p><input type="checkbox"/> Right</p> <p><input type="checkbox"/> Left</p> <p><input type="checkbox"/> Top</p> <p><input type="checkbox"/> Bottom</p>	 <p>The image shows the internal components of the main control board. It features a green printed circuit board (PCB) populated with various electronic components, including integrated circuits, capacitors, and resistors. The board is mounted in a metal enclosure, and several wires are connected to it. The components are organized in a structured manner, typical of a power electronics control board.</p>

Doc No.: ITC-TTW0902.02E – Rev.13


Appendix III photo documentation


Details of:	Water Pump for CGK030V4P
<p><b>View:</b></p> <p><input type="checkbox"/> General</p> <p><input type="checkbox"/> Front</p> <p><input type="checkbox"/> Rear</p> <p><input type="checkbox"/> Right</p> <p><input type="checkbox"/> Left</p> <p><input type="checkbox"/> Top</p> <p><input type="checkbox"/> Bottom</p>	

Details of:	Overall view for CGK040V4P
<p><b>View:</b></p> <p><input type="checkbox"/> General</p> <p><input type="checkbox"/> Front</p> <p><input type="checkbox"/> Rear</p> <p><input type="checkbox"/> Right</p> <p><input type="checkbox"/> Left</p> <p><input type="checkbox"/> Top</p> <p><input type="checkbox"/> Bottom</p>	

Doc No.: ITC-TTW0902.02E -- Rev.13

Appendix III photo documentation

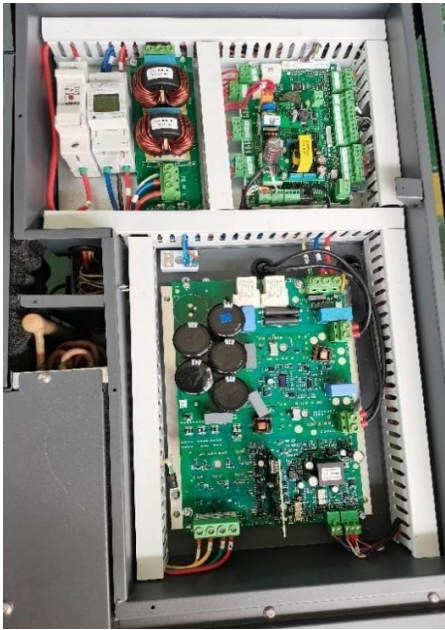
Details of:	Compressor for CGK040V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	


Details of:	Fan Motor for CGK040V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Doc No.: ITC-TTW0902.02E – Rev.13




Appendix III photo documentation

Details of:	Main Control Board for CGK040V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Details of:	Water Pump for CGK040V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Doc No.: ITC-TTW0902.02E – Rev.13


Appendix III photo documentation


Details of:	Overall view for CGK050V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Details of:	Compressor for CGK050V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Doc No.: ITC-TTW0902.02E – Rev.13


Appendix III photo documentation


Details of:	Fan Motor for CGK050V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Details of:	Main Control Board for CGK050V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix III photo documentation


Details of:	Water Pump for CGK050V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Details of:	Overall view for CGK060V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Doc No.: ITC-TTW0902.02E -- Rev.13


Appendix III photo documentation


Details of:	Compressor for CGK060V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Details of:	Fan Motor for CGK060V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix III photo documentation

Details of:	Main Control Board for CGK060V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Details of:	Water Pump for CGK060V4P
View:	
<input type="checkbox"/> General	
<input type="checkbox"/> Front	
<input type="checkbox"/> Rear	
<input type="checkbox"/> Right	
<input type="checkbox"/> Left	
<input type="checkbox"/> Top	
<input type="checkbox"/> Bottom	

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix IV Construction data form

Model : <u>CGK030V4P</u>		
Part		Technical data
1. Compressor		
	Manufacture:	Panasonic Wanbao Appliances Compressor (Guangzhou) Co., Ltd.
	Type:	H420D7KZAAC6
	Rated capacity:	2245W
	Serial-number:	F0000051
	Specification:	DC280V; R290
2. Condenser		
	Manufacture:	Jiangsu Yuanzhuo Equipment Manufactur Co.,Ltd
	Type:	ZL62FA-26AD-CG
	Heat exchanger:	Plate heat exchanger
	Dimension(mm):	526(L)mmX119(H)mmX63(D)mm
3. Evaporator		
	Manufacture:	Guangzhou Aotai Refrigeration Equipment Co.,Ltd.
	Type:	03KH-CP-01
	Heat exchanger:	Finned-coil heat exchanger
	Dimension(mm):	660(L)mmX750(H)mmX356.8(D)mm
4. Fan motor		
	Manufacture:	Wolong Electric Group Co., Ltd
	Type:	ZWB278D04A
	Fan type:	3 blade
	Specification:	DC310V; 102W
5. Main control board		
	Manufacture:	CAREL
	Type:	UP3F00200T3S04
	Specification:	220-240V~; 50Hz
6. Water pump		
	Manufacture:	GRUNDFOS
	Type:	UPM4XL K 25-90 130
	Specification:	230V~; 50/60Hz
*(Alternative)		
	Manufacture:	Shinhoo
	Type:	GPA25-9HW
	Specification:	230V~; 50/60Hz

Remark: \* means the test results were not performed on the alternative components.

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix IV Construction data form

Model : <b>CGK040V4P</b>		
Part		Technical data
1. Compressor		
	Manufacture:	Panasonic Wanbao Appliances Compressor (Guangzhou) Co., Ltd.
	Type:	H420D7KZAAC6
	Rated capacity:	2245W
	Serial-number:	F0000032
	Specification:	DC280V; R290
2. Condenser		
	Manufacture:	Jiangsu Yuanzhuo Equipment Manfactur Co.,Ltd
	Type:	ZL62FA-30AD-CG
	Heat exchanger:	Plate heat exchanger
	Dimension(mm):	526(L)mmX119(H)mmX71(D)mm
3. Evaporator		
	Manufacture:	Guangzhou Aotai Refrigeration Equipment Co.,Ltd.
	Type:	04KH-CP-01
	Heat exchanger:	Finned-coil heat exchanger
	Dimension(mm):	660.4(L)mmX900(H)mmX343.3(D)mm
4. Fan motor		
	Manufacture:	Wolong Electric Group Co., Ltd
	Type:	ZWB278D04A
	Fan type:	3 blade
	Specification:	DC310V; 102W
5. Main control board		
	Manufacture:	CAREL
	Type:	UP3F00200T3S04
	Specification:	220-240V~; 50Hz
6. Water pump		
	Manufacture:	GRUNDFOS
	Type:	UPM4XL K 25-90 130
	Specification:	230V~; 50/60Hz
*(Alternative)		
	Manufacture:	Shinhoo
	Type:	GPA25-9HW
	Specification:	230V~; 50/60Hz

Remark: \* means the test results were not performed on the alternative components.

Doc No.: ITC-TTW0902.02E – Rev.13



Appendix IV Construction data form

Model : <u>CGK050V4P</u>		
Part		Technical data
1. Compressor		
	Manufacture:	Panasonic Wanbao Appliances Compressor (Guangzhou) Co., Ltd.
	Type:	H550D7VZAAC6
	Rated capacity:	3120W
	Serial-number:	F9999998
	Specification:	DC520V; R290
2. Condenser		
	Manufacture:	Jiangsu Yuanzhuo Equipment Manufactur Co.,Ltd
	Type:	ZL62FA-40AD-CG
	Heat exchanger:	Plate heat exchanger
	Dimension(mm):	526(L)mmX119(H)mmX91(D)mm
3. Evaporator		
	Manufacture:	Guangzhou Aotai Refrigeration Equipment Co.,Ltd.
	Type:	05KH-CP-01
	Heat exchanger:	Finned-coil heat exchanger
	Dimension(mm):	660.4(L)mmX1300(H)mmX343.3(D)mm
4. Fan motor		
	Manufacture:	Wolong Electric Group Co., Ltd
	Type:	ZWB278D04A
	Fan type:	3 blade
	Specification:	DC310V; 102W
5. Main control board		
	Manufacture:	CAREL
	Type:	UP3F00200T3S04
	Specification:	220-240V~; 50Hz
6. Water pump		
	Manufacture:	GRUNDFOS
	Type:	UPM10L 25-105 130
	Specification:	230V~; 50/60Hz
*(Alternative)		
	Manufacture:	Shinhoo
	Type:	GPA25-11H
	Specification:	230V~; 50Hz

Remark: \* means the test results were not performed on the alternative components.

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix IV Construction data form

Model : <u>CGK060V4P</u>		
Part		Technical data
1. Compressor		
	Manufacture:	Panasonic Wanbao Appliances Compressor (Guangzhou) Co., Ltd.
	Type:	H650D7VZAAC6
	Rated capacity:	3640W
	Serial-number:	F9999998
	Specification:	DC520V; R290
2. Condenser		
	Manufacture:	Jiangsu Yuanzhuo Equipment Manufactur Co.,Ltd
	Type:	ZL62FA-40AD-CG
	Heat exchanger:	Plate heat exchanger
	Dimension(mm):	526(L)mmX119(H)mmX91(D)mm
3. Evaporator		
	Manufacture:	Guangzhou Aotai Refrigeration Equipment Co.,Ltd.
	Type:	06KH-CP-01
	Heat exchanger:	Finned-coil heat exchanger
	Dimension(mm):	660.4(L)mmX1300(H)mmX343.3(D)mm
4. Fan motor		
	Manufacture:	Wolong Electric Group Co., Ltd
	Type:	ZWB278D04A
	Fan type:	3 blade
	Specification:	DC310V; 102W
5. Main control board		
	Manufacture:	CAREL
	Type:	UP3F00200T3S04
	Specification:	220-240V~; 50Hz
6. Water pump		
	Manufacture:	GRUNDFOS
	Type:	UPM10L 25-105 130
	Specification:	230V~; 50/60Hz
*(Alternative)		
	Manufacture:	Shinhoo
	Type:	GPA25-11H
	Specification:	230V~; 50Hz

Remark: \* means the test results were not performed on the alternative components.

Doc No.: ITC-TTW0902.02E – Rev.13

Appendix V Equipment List

No.	Type	Manufacture	Model	Equipment ID	Calibration Due Date
1	Heat pump energy efficiency testing system	PINXIN	10HP	2017J00001	2023-11-24
2	Electromagnetic flowmeter	KROHNE	OPTIFLUX4100C	H17221264	2023-12-21
3	Anechoic rooms (hemi-anechoic rooms)	Guangzhou Kinte	-	NC-036-2	2024-10-07
4	AC source Supply	YANGHONG	YF-3600	VGDS-0637	2024-11-07
5	6 channel data logger	—	PXI-1033	VGDY-0257	2024-05-20
6	PULSE system	B & K	3660C	VGDY-0184	2024-04-12
7	Calibrator	B & K	4231	HJ-000095	2024-06-30
8	Long steel tape	—	5m	HJ-000150	2024-01-01
9	Temperature measurement system	—	—	NC-036-1	2024-06-07
10	Atmospheric pressure meter	—	—	HJ-000165	2023-11-22
11	Constant temperature water system	B & K	—	VGDS-0448	2024-04-18
12	Windscreen	B & K	WS002-5	—	—

-- End of Report --